FIGURE 1

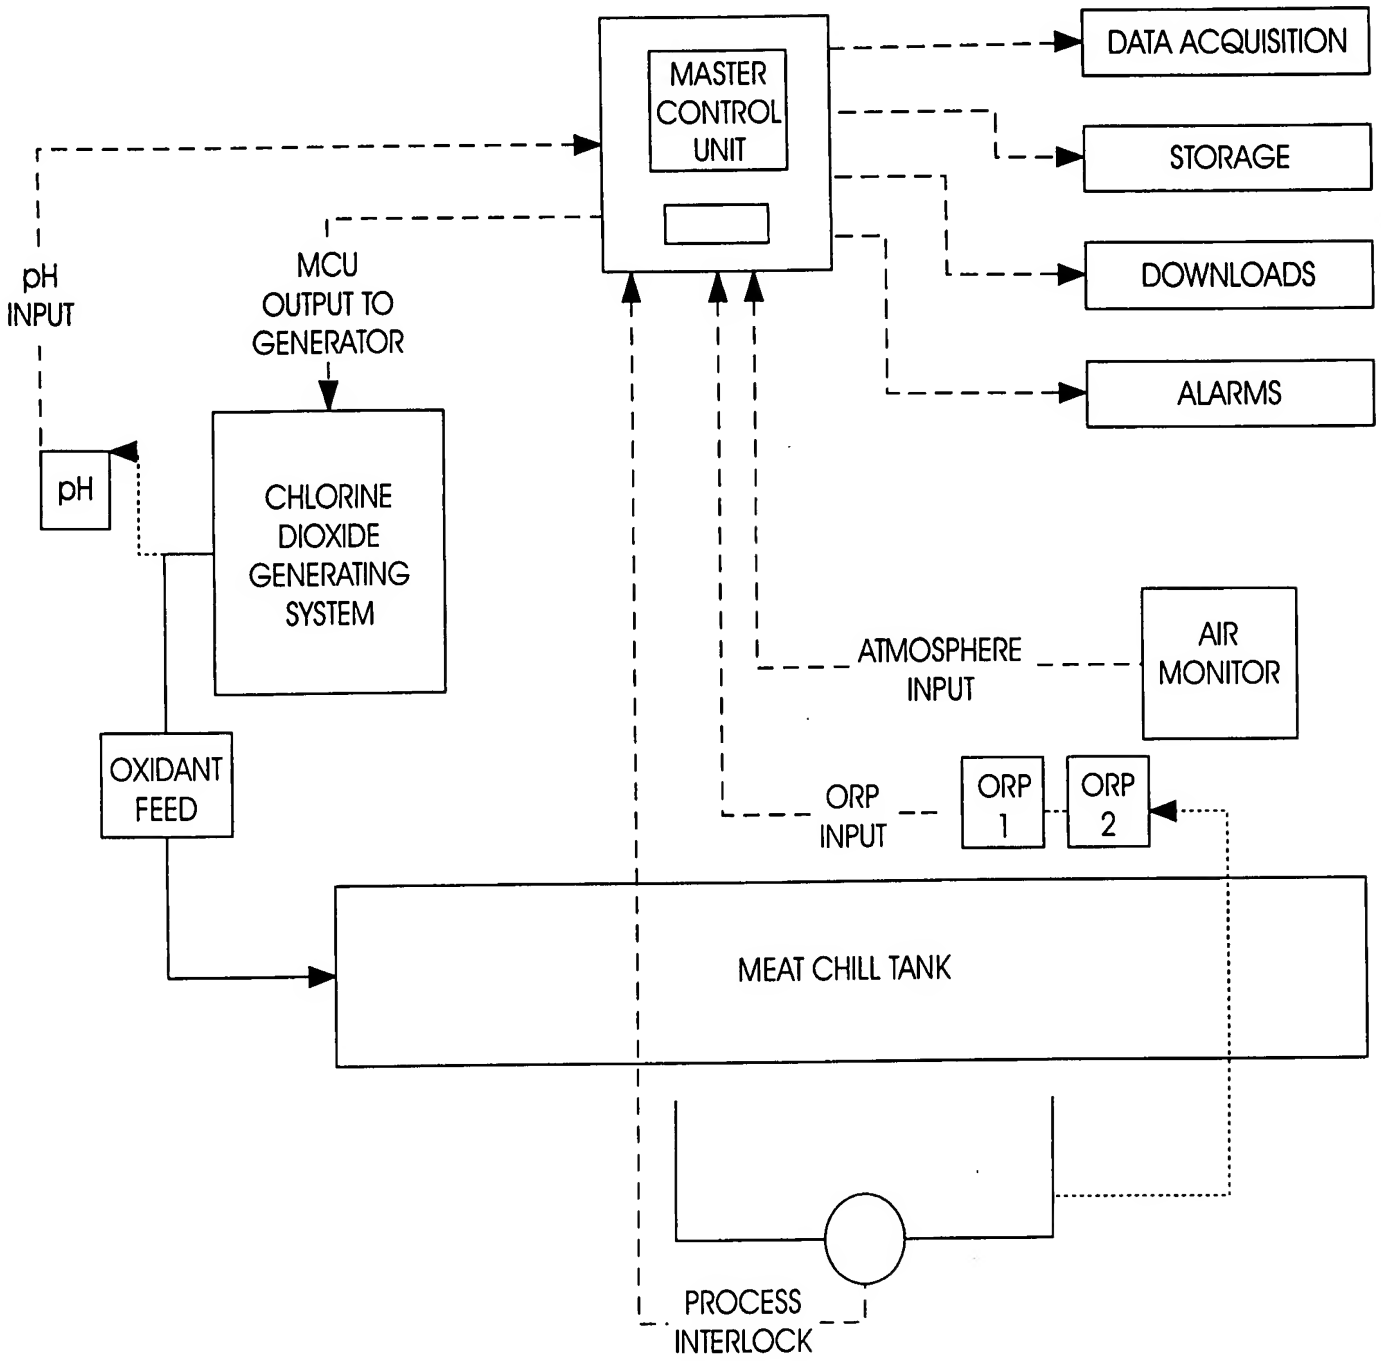
MASTER CONTROL UNIT
DATA ACQUISITION
STORAGE
DOWNLOADS
ALARMS
pH INPUT
MCU OUTPUT TO GENERATOR
pH
CHLORINE DIOXIDE GENERATING SYSTEM
ATMOSPHERE INPUT
AIR MONITOR
OXIDANT FEED
ORP INPUT
ORP 1
ORP 2
MEAT CHILL TANK
PROCESS INTERLOCK